Contact element, Cage Clamp, Front fixing, 1 NC, 24 V 3 A, 220 V 230 V 240 V 6 A



Part no. M22-CK01 Catalog No. 216385 Alternate Catalog M22-CK010

No.

EL-Nummer 4355767

(Norway)

| Delivery program Product range Basic function accessories Accessories Accessories Standard Approval Construction size Description Connection technique Front fixing Degree of Protection Connection to SmartWire-DT For use with Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 Maximum travel Minimum force for positivo opening Contact sequence Actuator sequence A | |
|--|---|
| Product range Basic function accessories Accessories Accessories Accessories Standard/Approval Construction size Description Connection technique Fixing Degree of Protection Connection to SmartWire-DT For use with Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 Maximum travel Minimum force for positive opening Contact sequence Accessories Auxiliary contact Trip-in UL/CSA, IEC NZM1/2/3/4 Cage Clamp is a registered traden Germany Front fixing IP20 no NZM1(-4), 2(-4), 3(-4), 4(-4) PNI(-4), 2(-4), 3(-4), | |
| Accessories Accessories Standard/Approval Construction size Description Connection technique Connection technique Fixing Degree of Protection Connection to SmartWire-DT For use with Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 Maximum travel Minimum force for positive opening Contact sequence Actuator | |
| Accessories Standard/Approval Construction size Description Connection technique Fixing Degree of Protection Connection to SmartWire-DT For use with Contacts N/C = Normally closed Notes Actuator travel and actuation force as per DIN EN 60947-5-1, Maximum travel Minimum force for positive opening Contact sequence Standard auxiliary contact, trip-in UU/CSA, IEC NZM1/2/3/4 Cage Clamp is a registered traden germany Cage Clamp Front fixing IP20 no NZM1(-1), 2(-1), 3(-1), 4(-4) PNI(-1), 2(-1), 3(-1), 4(-4) PNI(-1), 2(-1), 3(-1), 4(-4) NIST(-1), 2(-1), 3(-1), 4(-4) INC ■ safety function, by positive 1 NC ■ 1 | |
| Standard/Approval Construction size Description Connection technique Fixing Degrae of Protaction Connection to SmartWire-DT For use with Contacts N/C = Normally closed Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 Maximum travel Minimum force for positive opening Contact sequence UL/CSA, IEC NZM1/2/3/4 Cage Clamp is a registered traden derivation of cage Clamp is a registered traden derivation of protein and in the protein of protein in the protein in the protein of protein in the protein of protein in the protein of protein in the pr | |
| Description Connection technique Fixing Degree of Protection Connaction to SmartWire-DT For use with Contacts N/C = Normally closed Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 Maximum travel Minimum force for positive opening Contact sequence | indicating auxiliary switch |
| Description Connection technique Connection technique Fixing Degree of Protection Connection to SmartWire-DT For use with Contacts N/C = Normally closed Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 mm Maximum travel Minimum force for positive opening Contact sequence Cage Clamp is a registered traden Germany Pront fixing IP20 no NZM1(-4), 2(-4), 3(-4), 4(-4) PN1(-4), 2(-4 | |
| Germany Cage Clamp Fixing Degree of Protection Connection to SmartWire-DT For use with Contacts N/C = Normally closed Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 Maximum travel Minimum force for positive opening Contact sequence Germany Cage Clamp Front fixing IP20 no NZM1(-4), 2(-4), 3(-4), 4(-4) PN1(-4), 2(-4), 3(-4) | |
| Fixing Degree of Protection Connection to SmartWire-DT For use with Contacts N/C = Normally closed Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 Maximum travel Minimum force for positive opening Contact sequence Front fixing IP20 NZMI(-4), 2(-4), 3(-4), 4(-4) NZMI(-4), 2(-4), 3(-4), 4(-4) NISI(-4), 2(-4), 3(-4), 4(-4) NISI(- | emark of Wago Kontakttechnik GmbH/Minden, |
| Degree of Protection Connection to SmartWire-DT For use with Contacts N/C = Normally closed Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 mm 4.8 Maximum travel Minimum force for positive opening Contact sequence | |
| Contacts N/C = Normally closed Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 Maximum travel Minimum force for positive opening Contact sequence | |
| For use with NZM1(-4), 2(-4), 3(-4), 4(-4) PN1(-4), 2(-4), 3(-4), 4(-4), 4(-4) PN1(-4), 2(-4), 3(-4 | |
| PNI(-4), 2(-4), 3(-4) N(S)1(-4), 2(-4), 3(-4), 4(-4) Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 mm 4.8 Maximum travel Minimum force for positive opening N 15 Contact sequence | |
| Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 mm 4.8 Maximum travel mm 5.7 Minimum force for positive opening N 15 Contact sequence | |
| Notes Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 mm 4.8 Maximum travel Minimum force for positive opening Contact sequence | |
| Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 mm 4.8 Maximum travel mm 5.7 Minimum force for positive opening Contact sequence | |
| Maximum travel mm 5.7 Minimum force for positive opening N 15 Contact sequence | re opening to IEC/EN 60947-5-1 |
| Maximum travel Minimum force for positive opening Contact sequence In the sequence of the se | |
| Minimum force for positive opening Contact sequence | |
| Contact sequence L1 | |
| | |
| | |
| Contact travel diagram, stroke in connection with front element | |

| Contact diagram | 0 1.2 5.5 |
|--|---|
| Configuration | 1/4 3/6 2/5 |
| Connection type | Single contact |
| Description of HIA trip-indicating auxiliary contact | General trip indication '+', when tripped by shunt release, overload release, short-circuit release or by the residual-current release due to residual-current. Can be used with NZM1, 2, 3 circuit-breaker: a trip-indicating auxiliary contact can be clipped into the circuit-breaker: up to two standard auxiliary contacts can be clipped into the circuit-breaker: up to two standard auxiliary contacts can be clipped into the circuit-breaker. Any combinations of the auxiliary contact types are possible. Not in combination with switch-disconnector PN Marking on switch: HIA Labeling in FI-Block: HIAFI. If the trip-indicating auxiliary switch in the fault current block is used, the NC contacts operates as a N/O contact and the NC contact operates as an N/O contact. |
| Description standard auxiliary contact HIN | Switching with the main contacts Used for indicating and interlocking tasks. Can be used with NZM1 circuit-breaker: a standard auxiliary contact can be clipped into the circuit-breaker. Can be used with NZM2 size circuit-breaker: a standard auxiliary contact can be clipped into the circuit-breaker. Can be used with NZM3, 4 circuit-breaker: up to three standard auxiliary contacts can be clipped into the circuit-breaker. Any combinations of the auxiliary contact types are possible. Marking on switch: HIN. On combination with remote operator NZM-XR the right mounting location of standard auxiliary contact HIN can be fitted only with individual contacts. |
| Connection technique | Cage Clamp |

Notes

The following can be clipped into the switches:

- NZM1: a standard auxiliary contact
 NZM2: up to two M22-(C)K... standard auxiliary contacts
 NZM3: up to three M22-(C)K... standard auxiliary contacts
- NZM4: up to three M22-(C)K... standard auxiliary contacts

Any combinations of the auxiliary contact types are possible.

Marking on switch: HIN

In combination with remote operator NZM-XR... only single contacts can be fitted to some installation locations of the standard auxiliary contact.

NZM2: Only single contact can be fitted in left installation location of standard auxiliary contact.

NZM3: Only single contact can be fitted in installation locations of standard auxiliary contact.

NZM4: Only single contact can be fitted in right installation location of standard auxiliary contact.

Technical data

| General | | | |
|---|--------------|-------------------|--|
| Standards | | | IEC 60947-5-1 |
| Lifespan, mechanical | Operations | x 10 ⁶ | >5 |
| Operating frequency | Operations/h | | ≦ 3600 |
| Actuating force | | n | ≦ 5 |
| Degree of Protection | | | IP20 |
| Climatic proofing | | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | | |
| Open | | °C | -25 - +70 |
| Mechanical shock resistance to IEC 60068-2-27 Shock duration 11 ms, half-sinusoidal | | g | > 30 |
| Terminal capacities | | mm^2 | |
| Solid | | mm ² | 0.75 - 2.5 |
| Stranded | | mm^2 | 0.5 - 2.5 |
| Flexible with ferrule | | mm^2 | 0.5 - 1.5 |
| Contacts | | | |
| Box 12 To State 1 B | | 1/ 40 | 2000 |

| Rated impulse withstand voltage | U_{imp} | V AC | 6000 |
|---------------------------------------|-----------|------|-------|
| Rated insulation voltage | Ui | V | 500 |
| Overvoltage category/pollution degree | | | III/3 |

| Control circuit reliability | | | |
|--|----------------|--------------------|--|
| at 24 V DC/5 mA | H _F | Fault | < 10 ⁻⁷ (i.e. 1 failure to 10 ⁷ operations) |
| at 5 V DC/1 mA | H _F | Fault probabili | $< 5 \times 10^{-6}$ (i.e. 1 failure in 5 × 10^6 operations) |
| Max. short-circuit protective device | | probabili | LY |
| Fuseless | | Туре | PKZM0-10/FAZ-B6/1 |
| Fuse | gG/gL | Α | 10 |
| Switching capacity | 0 10 | | |
| Rated operational current | I _e | Α | |
| AC-15 | | | |
| 115 V | I _e | Α | 6 |
| 220 V 230 V 240 V | I _e | Α | 6 |
| 380 V 400 V 415 V | | A | 4 |
| | l _e | | |
| 500 V | l _e | Α | 2 |
| DC-13 | | | |
| 24 V | l _e | Α | 3 |
| 42 V | l _e | Α | 1.7 |
| 60 V | l _e | Α | 1.2 |
| 110 V | l _e | Α | 0.8 |
| 220 V | I _e | Α | 0.3 |
| Lifespan, electrical | | | |
| AC-15 | | | |
| 230 V/0.5 A | Operations | x 10 ⁶ | 1.6 |
| 230 V/1.0 A | Operations | x 10 ⁶ | 1 |
| 230 V/3.0 A | | | |
| | Operations | x 10 ⁶ | 0.7 |
| DV-13 | | | |
| 12 V/2.8 A | Operations | x 10 ⁶ | 1.2 |
| Auxiliary contacts | | ., | |
| Rated operational voltage | U _e | V | |
| Rated operational voltage | Ue | V AC | 500 |
| Rated operational voltage, max. | Ue | V DC | 220 |
| Conventional thermal current | $I_{th} = I_e$ | CSA | 4 |
| Rated operational current | I _e | Α | |
| Different rated operational currents when used as auxiliary contact for NZM circuit-breaker | | | M22- M22- XHIV (C)K10(01)CK11(02) (20) bei AC = 50/60 Hz Bemessungsbetriebsstrom |
| | | | AC-1515 le A 4 4 4 V |
| | | | 230 le A 4 4 |
| | | | V 400 le A 2 - 2 |
| | | | V 500 le A 1 - 1 |
| | | | V |
| | | | DC-1 3 4 V le A 3 3 3 42 V le A 1.7 1 1.5 |
| | | | 60 V le A 1.2 0.8 0.8 110 le A 0.6 0.5 0.5 |
| | | | V |
| | | | 220 le A 0.3 0.2 0.2 V |
| Rated conditional short-circuit current | Iq | kA | 1 |
| Short-circuit protection | | | |
| max. fuse | | A gG/gL | 10 |
| Max. miniature circuit-breaker | | A | FAZ-B6/B1 |
| Operating times | | | |
| | | | Early-make time of the HIV compared to the main contacts during with make and |
| | | | break switching. |

| | | | (switch times with manual operation): |
|---|---|-----------------|---|
| | | | NZM1, PN1, N(S)1: ca. 20 ms |
| | | | NZM2, PN2, N(S)2: ca. 20 ms |
| | | | NZM3, PN3, N(S)3: ca. 20 ms |
| | | | NZM4, N(S)4: approx. 90 ms, the HIV switch early Off switching not forward. |
| Terminal capacities | r | mm ² | |
| Solid or flexible conductor, with ferrule | ī | mm ² | 1 x (0,5 - 1,5) 2 x (0,5 - 0,75) |
| Other technical data (sheet catalogue) | | | Maximum equipment and position of the internal accessories |

Design verification as per IEC/EN 61439

| boolgii vormoudion do por 120, 211 or 100 | | | |
|--|-------------------|----|--|
| Technical data for design verification | | | |
| Rated operational current for specified heat dissipation | In | Α | 6 |
| Heat dissipation per pole, current-dependent | P _{vid} | W | 0.11 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 0 |
| Static heat dissipation, non-current-dependent | P _{vs} | W | 0 |
| Heat dissipation capacity | P _{diss} | W | 0 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 70 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | | | Is the panel builder's responsibility. |
| 10.9 Insulation properties | | | |
| 10.9.2 Power-frequency electric strength | | | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | | | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | | | Is the panel builder's responsibility. |
| 10.10 Temperature rise | | | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | | | Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:specifications}$ |
| 10.12 Electromagnetic compatibility | | | Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$ |
| 10.13 Mechanical function | | | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

Technical data ETIM 8.0


| Low-voltage industrial components (EG000017) / Auxiliary contact block (EC000041) | | |
|--|---|--|
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Component for low-voltage switching technology / Auxiliary switch block (ecl@ss10.0.1-27-37-13-02 [AKN342013]) | | |
| Number of contacts as change-over contact | 0 | |
| Number of contacts as normally open contact | 0 | |
| Number of contacts as normally closed contact | 1 | |
| Number of fault-signal switches | 0 | |

| Rated operation current le at AC-15, 230 V | А | 6 |
|--|---|-----------------------------|
| Type of electric connection | | Spring clamp connection |
| Model | | Top mounting and integrable |
| Mounting method | | Front fastening |
| Lamp holder | | None |


Approvals

| Product Standards | IEC/EN 60947-5; UL 508; CSA-C22.2 No. 14-05; CSA-C22.2 No. 94-91; CE marking |
|-----------------------------|--|
| UL File No. | E29184 |
| UL Category Control No. | NKCR |
| CSA File No. | 012528 |
| CSA Class No. | 3211-03 |
| North America Certification | UL listed, CSA certified |
| Degree of Protection | UL/CSA Type: - |

Dimensions

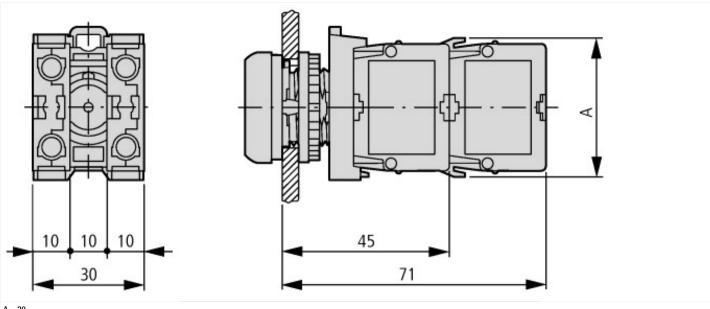



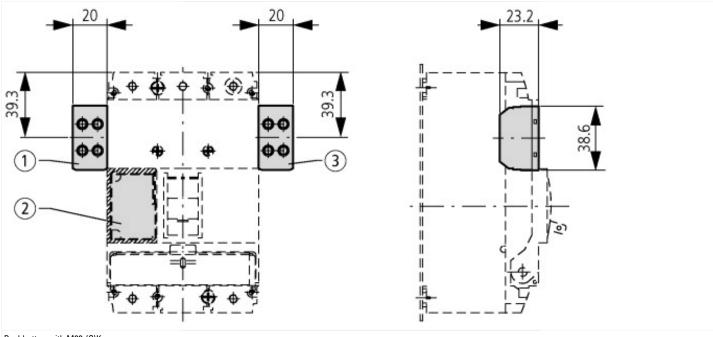

Pushbutton with M22-(C)K... Pushbutton with M22-(C) LED... + M22-XLED...

Additional product information (links)

IL04716002Z (AWA1160-1745) RMQ-Titan System

| IL04716002Z (AWA1160-1745) RMQ-Titan System | https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL04716002Z2021_07.pdf |
|--|--|
| DGUV Test Mark Customer Information | $http://www.dguv.de/medien/dguv-test-medien/_pdf_zip_doc_ppt/agb-und-pzo/dguv_test_zeichen_infoblatt_kunden.pdf$ |
| Maximum equipment and position of the internal accessories | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.178 |