




**Housing, Emergency stop/emergency switching off pushbutton, Mushroom-shaped, 38 mm, Non-illuminated, Pull-to-release function, 2 NC, Screw connection, Red (RAL 3000), Yellow**



**Part no.** M22-PV/KC02/IY  
**Catalog No.** 216524  
**Alternate Catalog No.** M22-PV-KC02-IYQ  
**EL-Nummer (Norway)** 4355297

**Delivery program**

|   |   |      |  |
|---|---|------|--|
| Product range   |   |      | RMQ-Titan  |
| Basic function  |   |      | Housing<br>Controlled stop pushbuttons/emergency-stop buttons  |
| Mounting hole diameter  | ∅ | mm   | 22.5   |
| Single unit/Complete unit   |   |      | Complete unit  |
| Design  |   |      | Mushroom-shaped  |
| Diameter  | ∅ | mm   | 38   |
| Illumination  |   |      | Non-illuminated  |
| Approval  |   |      | <b>totally insulated</b>   |
|   |   |      | Pull-to-release function   |
| Connection type   |   |      | Screw connection   |
| Description   |   |      | Tamper-proof according to ISO 13850/EN 418   |
| Number of locations   |   | Qty. | 1  |
| <b>Colour</b>   |   |      |  |
| Mushroom head   |   |      | Red  |
|   |   |      |    |
| Enclosure covers  |   |      | Yellow   |
| RAL Value   |   |      | RAL 3000   |
| Degree of Protection  |   |      | IP66, IP69   |
| Connection to SmartWire-DT  |   |      | no   |
| <b>Contacts</b>   |   |      |  |
| N/C = Normally closed   |   |      | 2 NC   |
| Notes   |   |      |  = safety function, by positive opening to IEC/EN 60947-5-1 |
| <b>Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1</b> |   |      |  |
|   |   | mm   | 4.8  |
| Maximum travel  |   | mm   | 5.7  |
| Minimum force for positive opening  |   | N    | 30   |
| Contact sequence  |   |      |    |
| Housing   |   |      | Insulated material   |

## Technical data

### General

|                             |              |               |  |
|-----------------------------|--------------|---------------|--|
| Standards                   |              |               | IEC/EN 60947<br>VDE 0660   |
| Lifespan, mechanical        | Operations   | $\times 10^6$ | > 0.1  |
| Operating frequency         | Operations/h |               | $\leq 600$   |
| Actuating force             | n            |               | $\leq 50$  |
| Climatic proofing           |              |               | Damp heat, constant, to IEC 60068-2-78<br>Damp heat, cyclic, to IEC 60068-2-30   |
| Degree of Protection        |              |               | IP66, IP69   |
| Ambient temperature         |              |               |  |
| Open                        |              | °C            | -25 - +70  |
| Mounting position           |              |               | As required  |
| Mechanical shock resistance |              | g             | 50<br>Shock duration 11 ms<br>Sinusoidal<br>according to IEC 60068-2-27  |
| shipping classification     |              |               | DNV<br>GL<br>LR  |
|                             |              |               |    |

### Contacts

|   |       |    |   |
|---|-------|----|---|
| Rated conditional short-circuit current | $I_q$ | kA | 1 |
|---|-------|----|---|

## Design verification as per IEC/EN 61439

|  |            |    |  |
|--|------------|----|--|
| Technical data for design verification   |            |    |  |
| Rated operational current for specified heat dissipation   | $I_n$      | A  | 6  |
| Heat dissipation per pole, current-dependent   | $P_{vid}$  | W  | 0.11   |
| Equipment heat dissipation, current-dependent  | $P_{vid}$  | W  | 0  |
| Static heat dissipation, non-current-dependent   | $P_{vs}$   | W  | 0  |
| Heat dissipation capacity  | $P_{diss}$ | W  | 0  |
| Operating ambient temperature min.   |            | °C | -25  |
| Operating ambient temperature max.   |            | °C | 70   |
| IEC/EN 61439 design verification   |            |    |  |
| 10.2 Strength of materials and parts   |            |    |  |
| 10.2.2 Corrosion resistance  |            |    |  |
|  |            |    | Meets the product standard's requirements.                         |
| 10.2.3.1 Verification of thermal stability of enclosures   |            |    |  |
|  |            |    | Meets the product standard's requirements.                         |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat   |            |    |  |
|  |            |    | Meets the product standard's requirements.                         |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |            |    |  |
|  |            |    | Meets the product standard's requirements.                         |
| 10.2.4 Resistance to ultra-violet (UV) radiation   |            |    |  |
|  |            |    | Please enquire   |
| 10.2.5 Lifting   |            |    |  |
|  |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact   |            |    |  |
|  |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions  |            |    |  |
|  |            |    | Meets the product standard's requirements.                         |
| 10.3 Degree of protection of ASSEMBLIES  |            |    |  |
|  |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances   |            |    |  |
|  |            |    | Meets the product standard's requirements.                         |
| 10.5 Protection against electric shock   |            |    |  |
|  |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components   |            |    |  |
|  |            |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections  |            |    |  |
|  |            |    | Is the panel builder's responsibility.                             |
| 10.8 Connections for external conductors   |            |    |  |
|  |            |    | Is the panel builder's responsibility.                             |
| 10.9 Insulation properties   |            |    |  |
| 10.9.2 Power-frequency electric strength   |            |    |  |
|  |            |    | Is the panel builder's responsibility.                             |

|  |  |  |  |
|--|--|--|--|
| 10.9.3 Impulse withstand voltage                         |  |  | Is the panel builder's responsibility.   |
| 10.9.4 Testing of enclosures made of insulating material |  |  | Is the panel builder's responsibility.   |
| 10.10 Temperature rise                                   |  |  | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating                               |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.12 Electromagnetic compatibility                      |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.13 Mechanical function                                |  |  | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.                         |

## Technical data ETIM 8.0

Low-voltage industrial components (EG000017) / Control circuit devices combination in enclosure (EC000225)





Electric engineering, automation, process control engineering / Low-voltage switch technology / Command and alarm device / Command and alarm device combination in housing (ecl@ss10.0.1-27-37-12-16 [AKF034014])


|   |  |   |           |
|---|--|---|-----------|
| Number of command positions                   |  |   | 1         |
| Number of push buttons                        |  |   | 0         |
| Number of indicator lights                    |  |   | 0         |
| Number of key switches                        |  |   | 0         |
| Number of selector switches                   |  |   | 0         |
| Number of mushroom-shaped push-buttons        |  |   | 1         |
| Suitable for emergency stop                   |  |   | Yes       |
| Rated control supply voltage Us at AC 50HZ    |  | V | 115 - 500 |
| Rated control supply voltage Us at AC 60HZ    |  | V | 115 - 500 |
| Rated control supply voltage Us at DC         |  | V | 24 - 220  |
| Colour housing cover                          |  |   | Yellow    |
| Material housing                              |  |   | Plastic   |
| Number of contacts as normally open contact   |  |   | 0         |
| Number of contacts as normally closed contact |  |   | 2         |
| Number of contacts as change-over contact     |  |   | 0         |
| Degree of protection (IP)                     |  |   | Other     |
| Degree of protection (NEMA)                   |  |   | 4X, 13    |

## Approvals

|                             |  |  |  |
|-----------------------------|--|--|--|
| Product Standards           |  |  | IEC/EN 60947-5; UL 508; CSA-C22.2 No. 14-05; CSA-C22.2 No. 94-91; CE marking |
| UL File No.                 |  |  | E29184   |
| UL Category Control No.     |  |  | NKCR   |
| CSA File No.                |  |  | 012528   |
| CSA Class No.               |  |  | 3211-03  |
| North America Certification |  |  | UL listed, CSA certified   |
| Degree of Protection        |  |  | UL/CSA Type 3R, 4X, 12, 13   |

## Dimensions

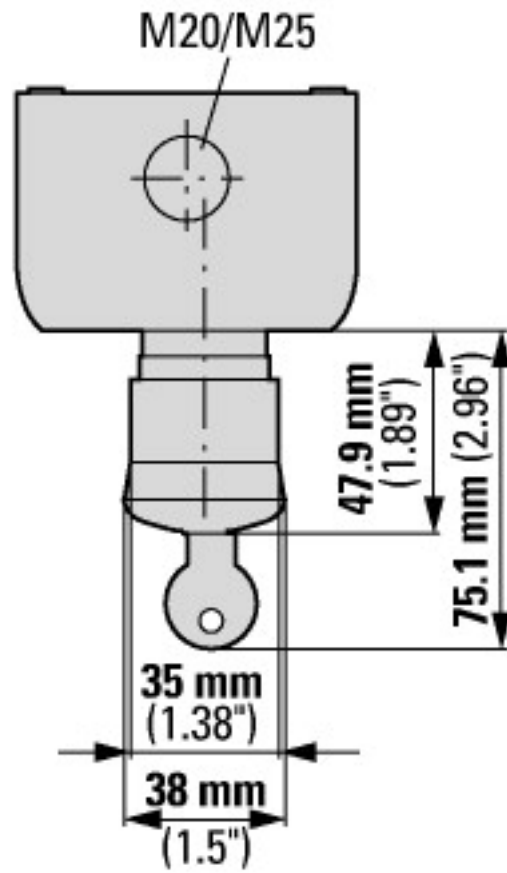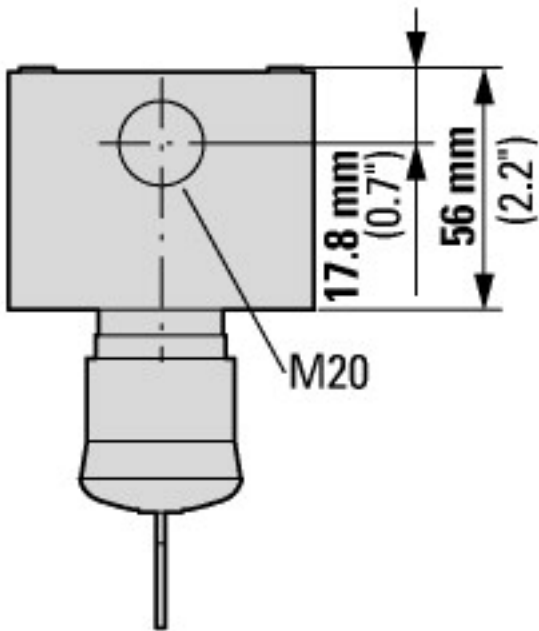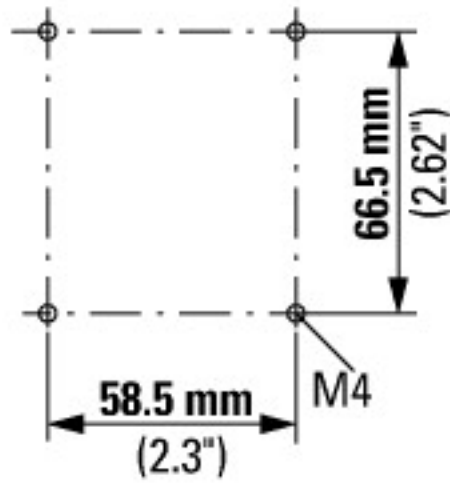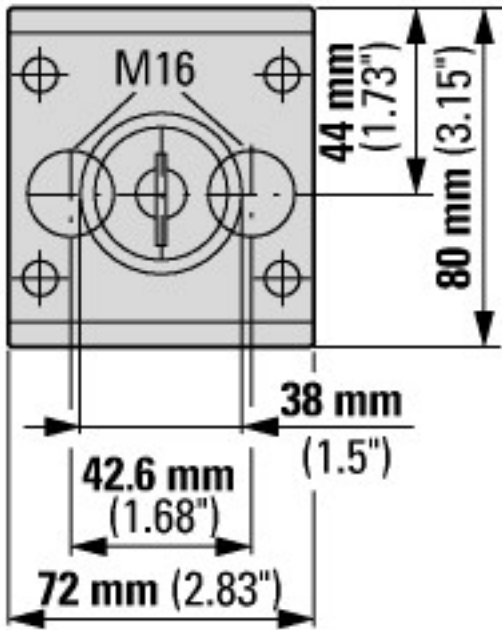

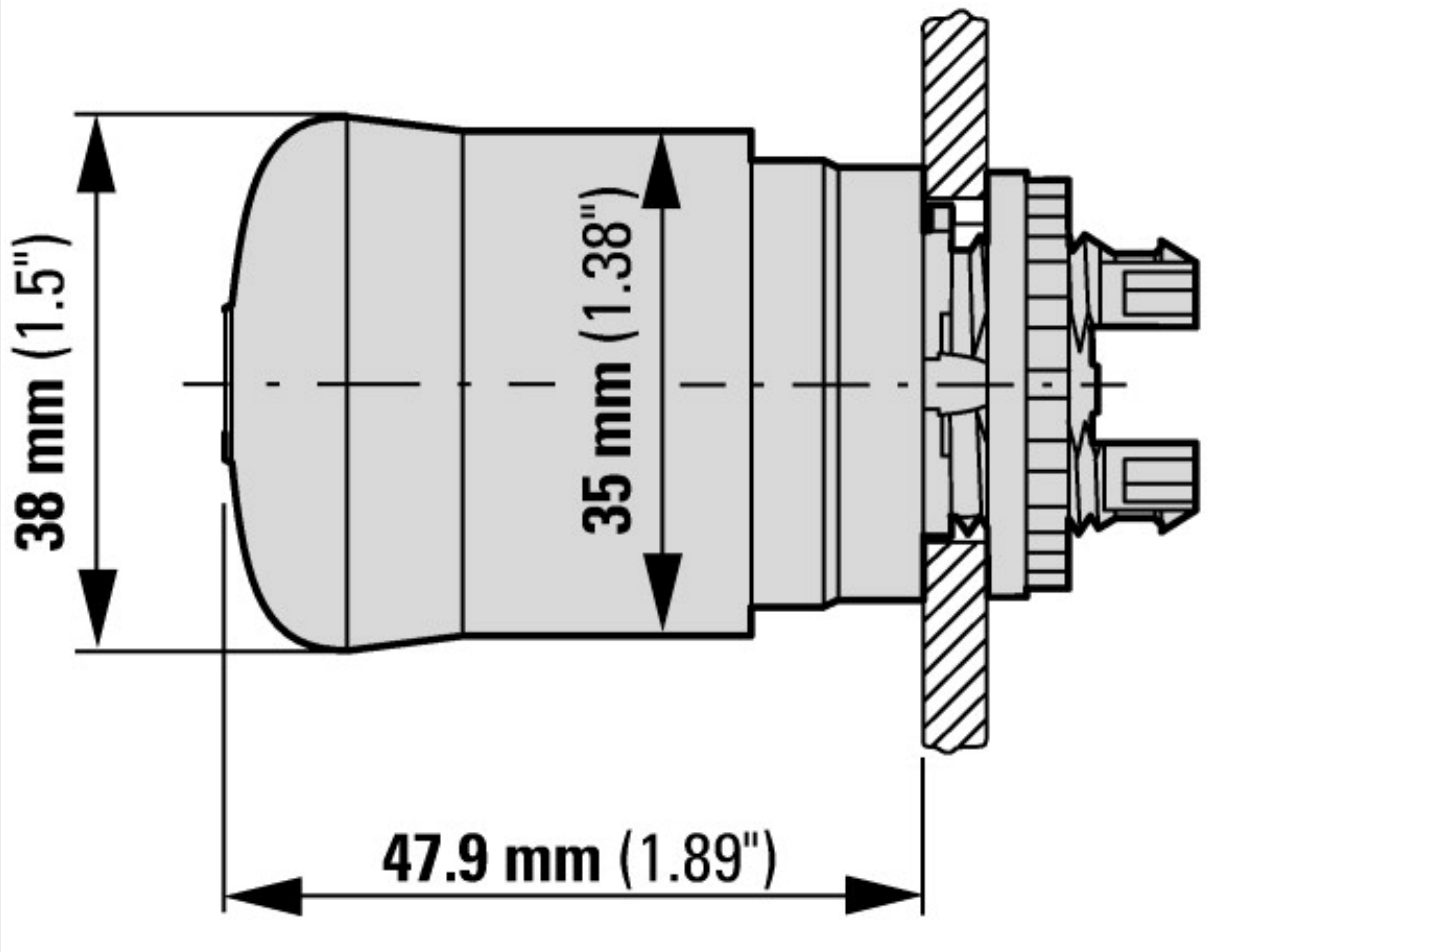

### Additional product information (links)

#### IL04716005 RMQ-Titan: Emergency-stop buttons, emergency-stop buttons

IL04716005 RMQ-Titan: Emergency-stop buttons, emergency-stop buttons [https://es-assets.eaton.com/DOCUMENTATION/AWA\\_INSTRUCTIONS/IL04716005Z.pdf](https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL04716005Z.pdf)

#### IL04716003Z (AWA1160-1746, AWA116-662, IL04716003E) RMQ-Titan system

IL04716003Z (AWA1160-1746, AWA116-662, IL04716003E) RMQ-Titan system [https://es-assets.eaton.com/DOCUMENTATION/AWA\\_INSTRUCTIONS/IL04716003Z2021\\_08.pdf](https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL04716003Z2021_08.pdf)

DGUV Test Mark Customer Information [http://www.dguv.de/medien/dguv-test-medien/\\_pdf\\_zip\\_doc\\_ppt/agb-und-pzo/dguv\\_test\\_zeichen\\_infoblatt\\_kunden.pdf](http://www.dguv.de/medien/dguv-test-medien/_pdf_zip_doc_ppt/agb-und-pzo/dguv_test_zeichen_infoblatt_kunden.pdf)