### DATASHEET - M22-WRK3

Changeover switch, RMQ-Titan, With thumb-grip, maintained, 3 positions, Bezel: titanium



Part no.	M22-WRK3
Catalog No.	216872
Alternate Catalog	M22-WRK3Q
No.	
EL-Nummer	4355319
(Norway)	

## **Delivery program**

Product range			RMQ-Titan
Basic function			Selector switch actuators
Mounting hole diameter	Ø	mm	22.5
Single unit/Complete unit			Single unit
Design			With thumb-grip
			maintained
Function:			
			60° # 60°
			3 positions
Degree of Protection			IP66
Front ring			Bezel: titanium
Connection to SmartWire-DT			yes with SWD-RMQ connections
Instructions			Stay-put/spring-return function, can be changed with coding parts M22-XC-Y with plunger bridge for the middle contact

# Technical data

		IEC/EN 60947 VDE 0660
Operations	x 10 <sup>6</sup>	> 0.1
Operations/h		≦ 2000
	Nm	≦ 0.3
		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
		IP66
	°C	-25 - +70
	°C	- 40 - + 80
		As required
	g	30 Shock duration 11 ms Sinusoidal according to IEC 60068-2-27
		DNV GL LR
		<b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b> <b>Contractions</b>
		Operations/h Nm °C °C

Indoor and protected outdoor installation

Design verification as per IEC/EN 61439			
Technical data for design verification			
Rated operational current for specified heat dissipation	In	А	0
Heat dissipation per pole, current-dependent	P <sub>vid</sub>	W	0
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	0
Static heat dissipation, non-current-dependent	P <sub>vs</sub>	W	0
Heat dissipation capacity	P <sub>diss</sub>	W	0
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Please enquire
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			Not applicable.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

#### **Technical data ETIM 8.0**

Low-voltage industrial components (EG000017) / Front element for selector switch (EC000222)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Command alarm device / Front element for selector switches (ecl@ss10.0.1-27-37-12-13 Number of switch positions Type of control element Suitable for illumination Colour control element Suitable for illumination Colour sentrol element


Colour control element		Black
Colour indicator light cap		Other
Construction type lens		Round
Hole diameter	mm	22.5
Width opening	mm	0
Height opening	mm	0
Switching function latching		Yes
Spring-return		No
With front ring		Yes
Material front ring		Plastic
Colour front ring		Titanium
Degree of protection (IP), front side		IP66


Degree	of	protection	(NEMA)
--------	----	------------	--------


4X, 13

Approvals	
Product Standards	IEC/EN 60947-5; UL 508; CSA-C22.2 No. 14-05; CSA-C22.2 No. 94-91; CE marking
UL File No.	E29184
UL Category Control No.	NKCR
CSA File No.	012528
CSA Class No.	3211-03
North America Certification	UL listed, CSA certified
Degree of Protection	UL/CSA Type 3R, 4X, 12, 13

## **Dimensions**

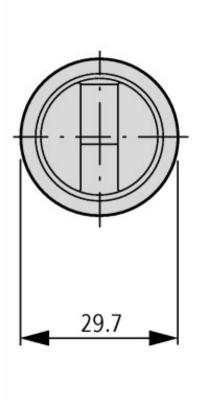

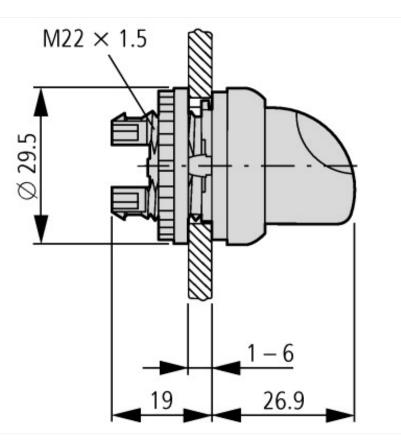

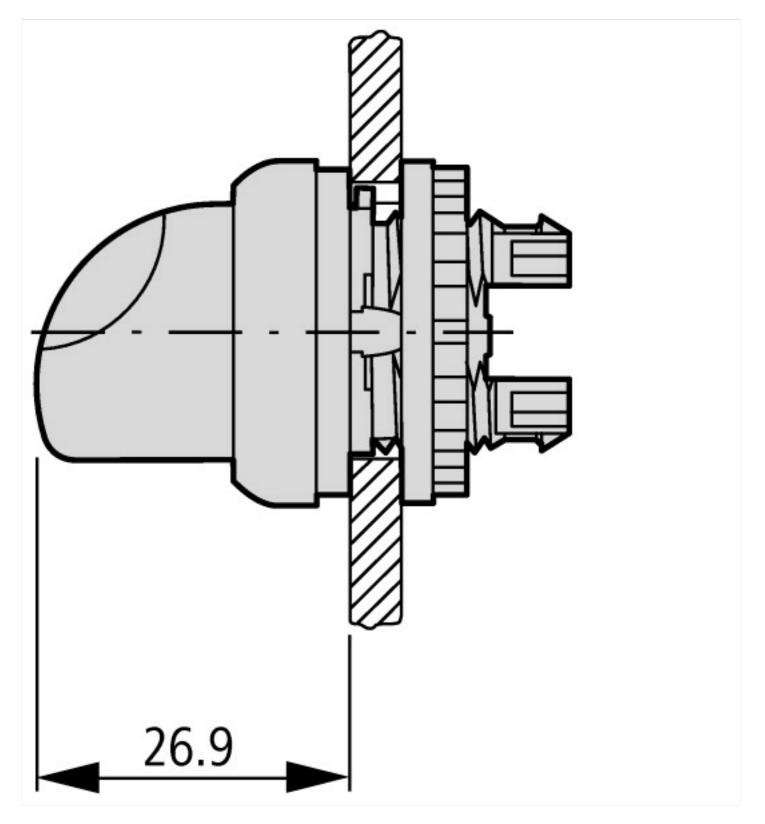

## Additional product information (links)

#### IL04716002Z (AWA1160-1745) RMQ-Titan System

IL04716002Z (AWA1160-1745) RMQ-Titan https://es-assets.eaton.com/DOCUMENTATION/AWA\_INSTRUCTIONS/IL04716002Z2021\_07.pdf System